



SCHEDULE		
Item	Unit	Qty.
Guard rails for water tank protection: Cast 75mm black pipe monolithically with the concrete slab (no post-casting drilling), the anchorage to be 200mm.	m	40.00

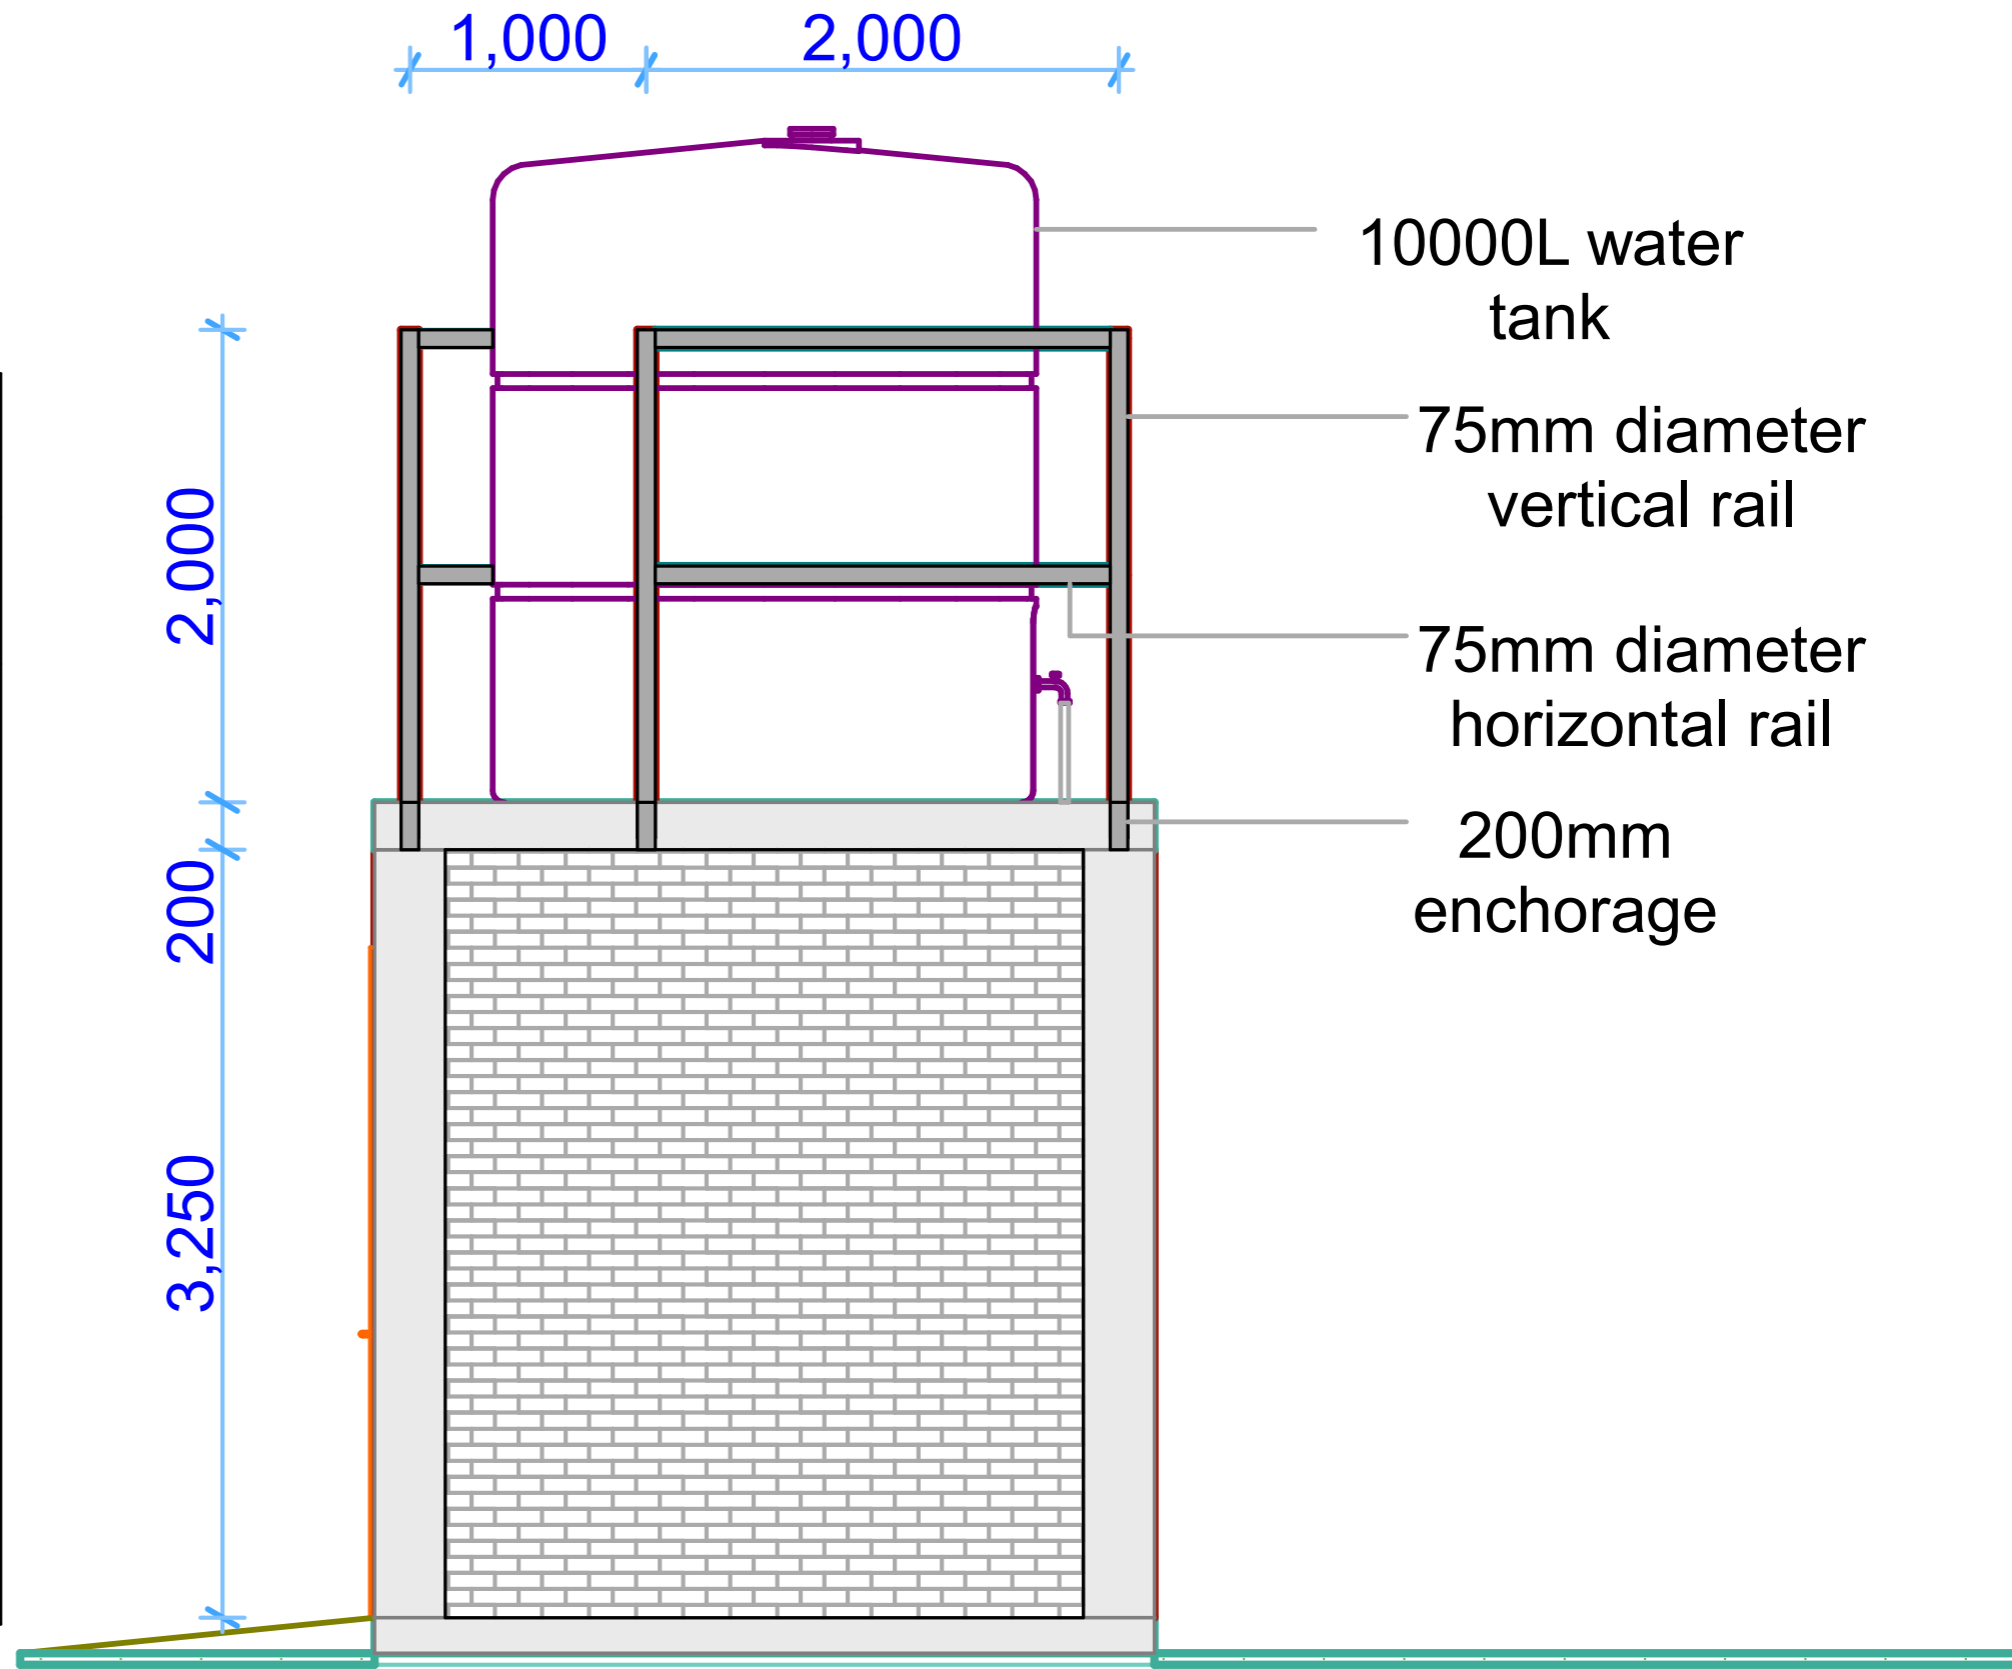


WATER TOWER AT WASH FACILITY

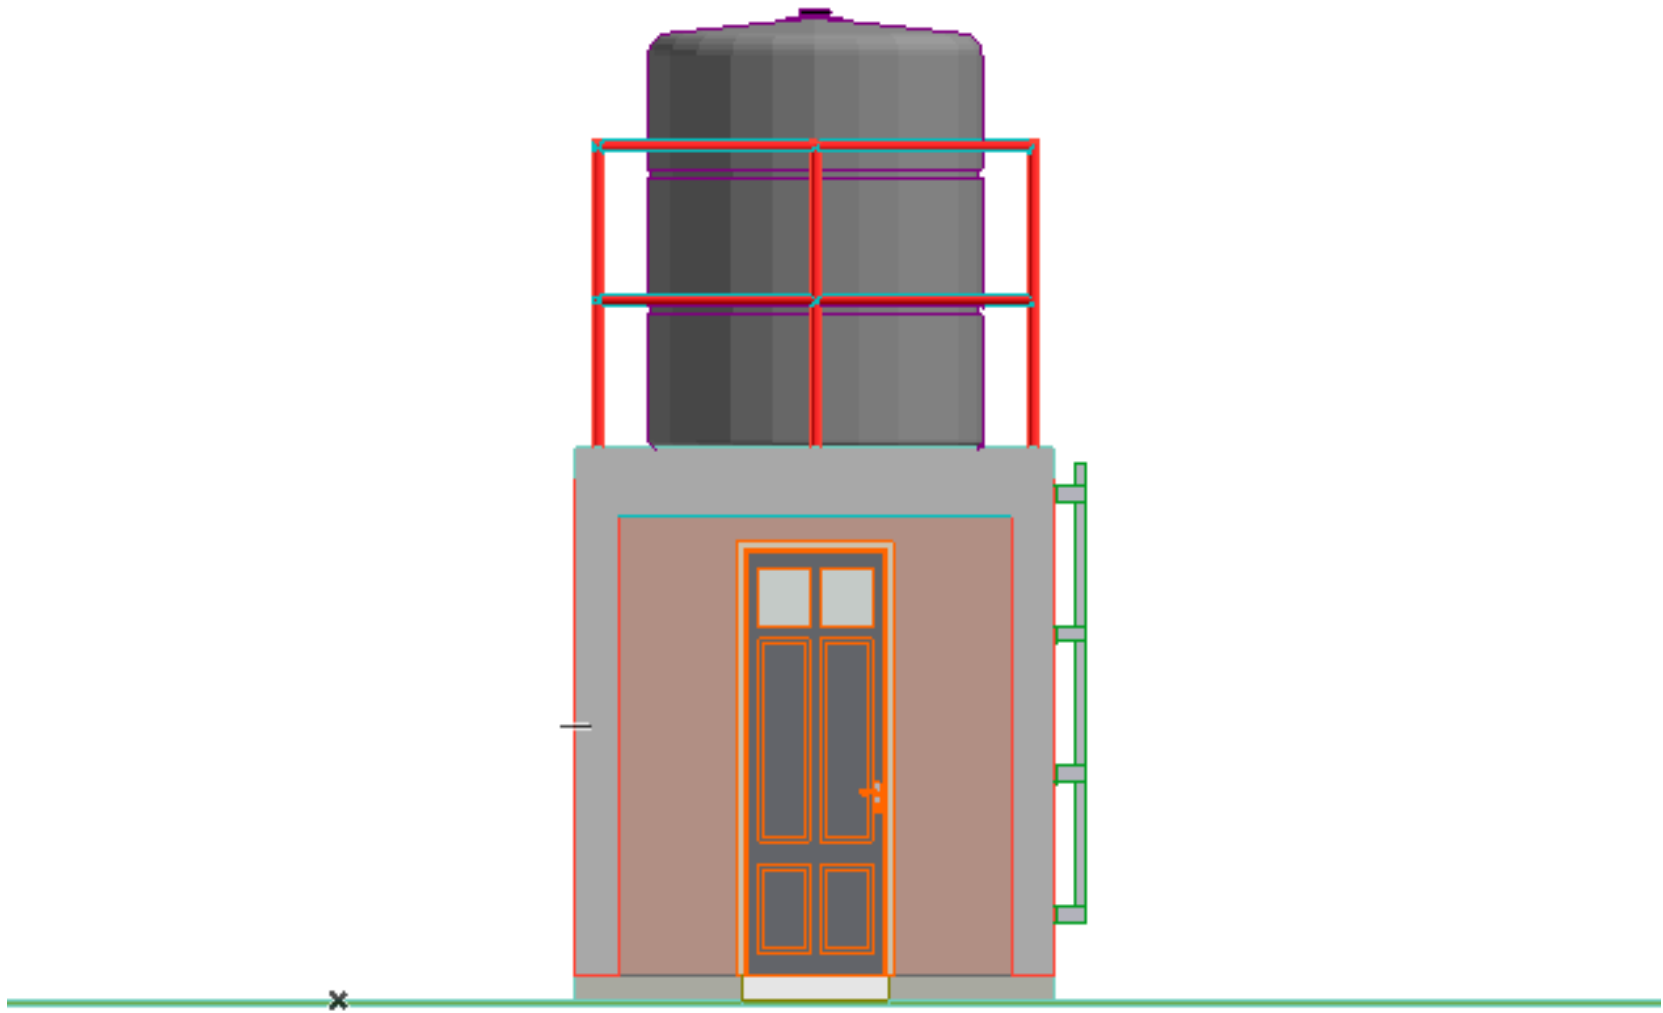


WATER TOWER AT WASH FACILITY



WATER TOWER AT WASH FACILITY

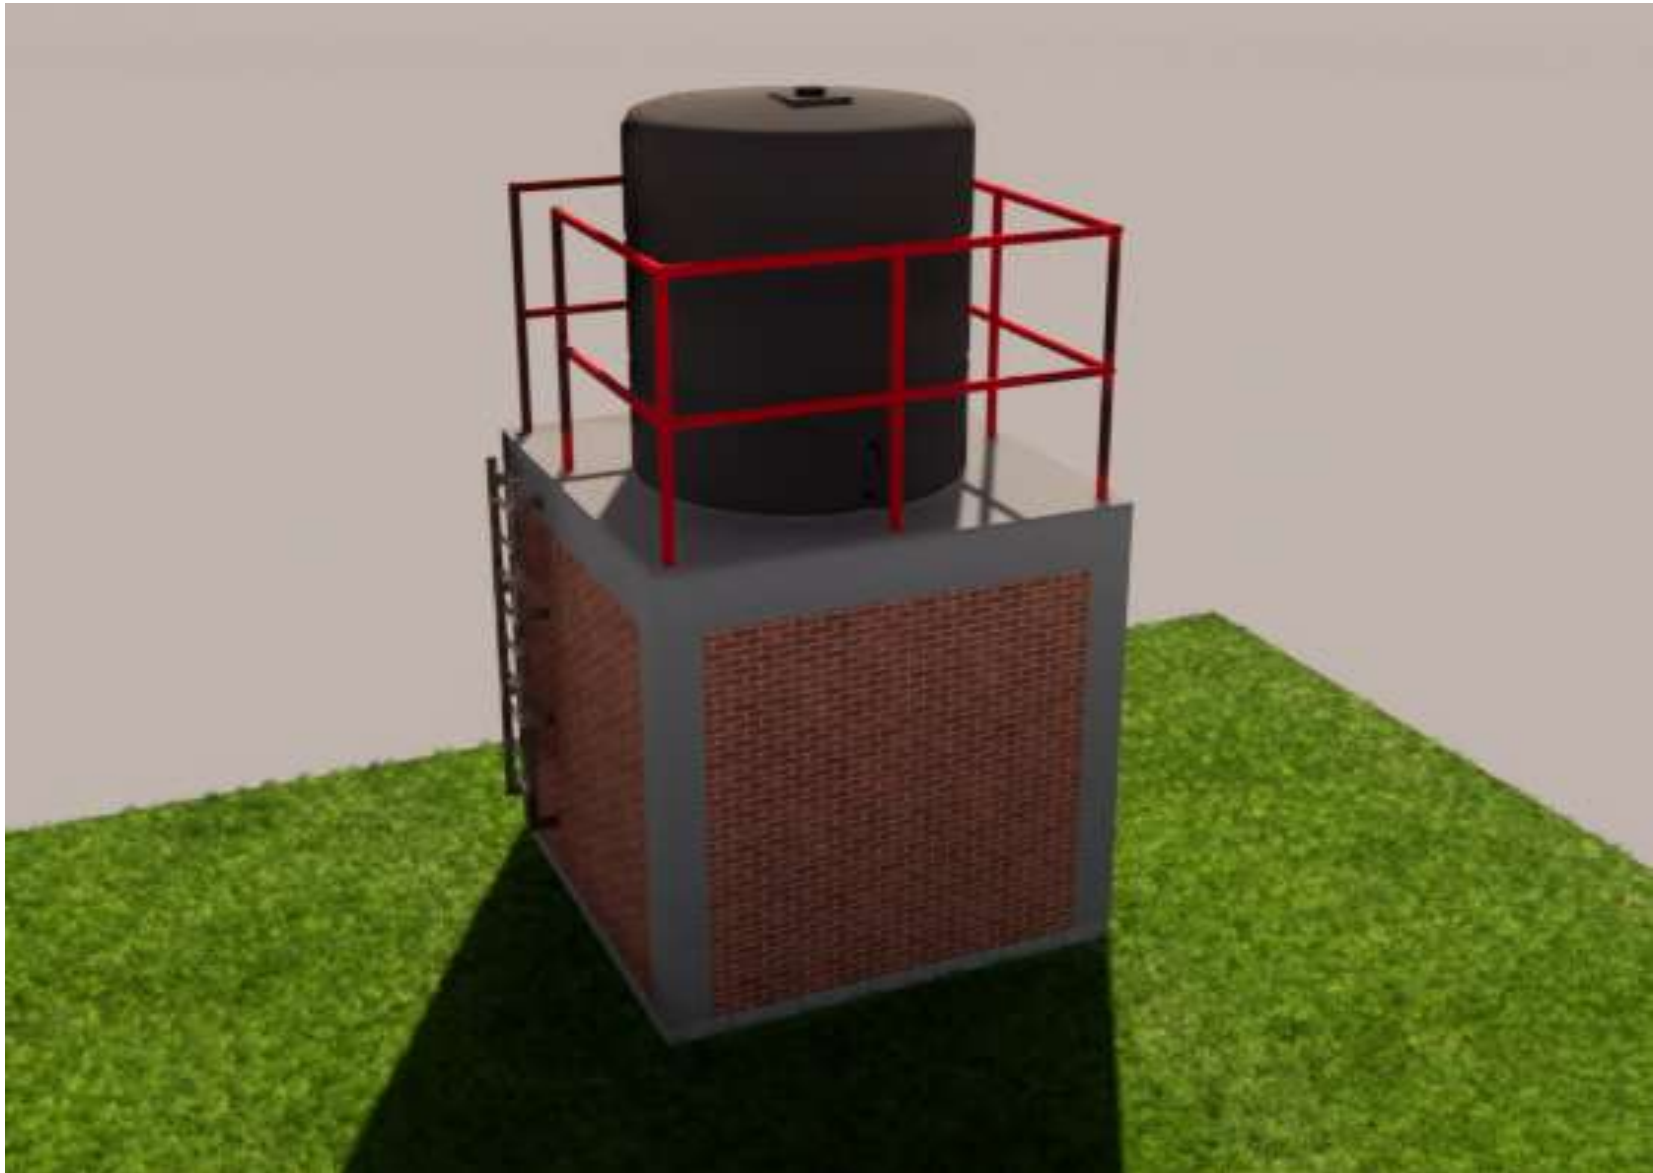

WATER TOWER IN DORMITORY

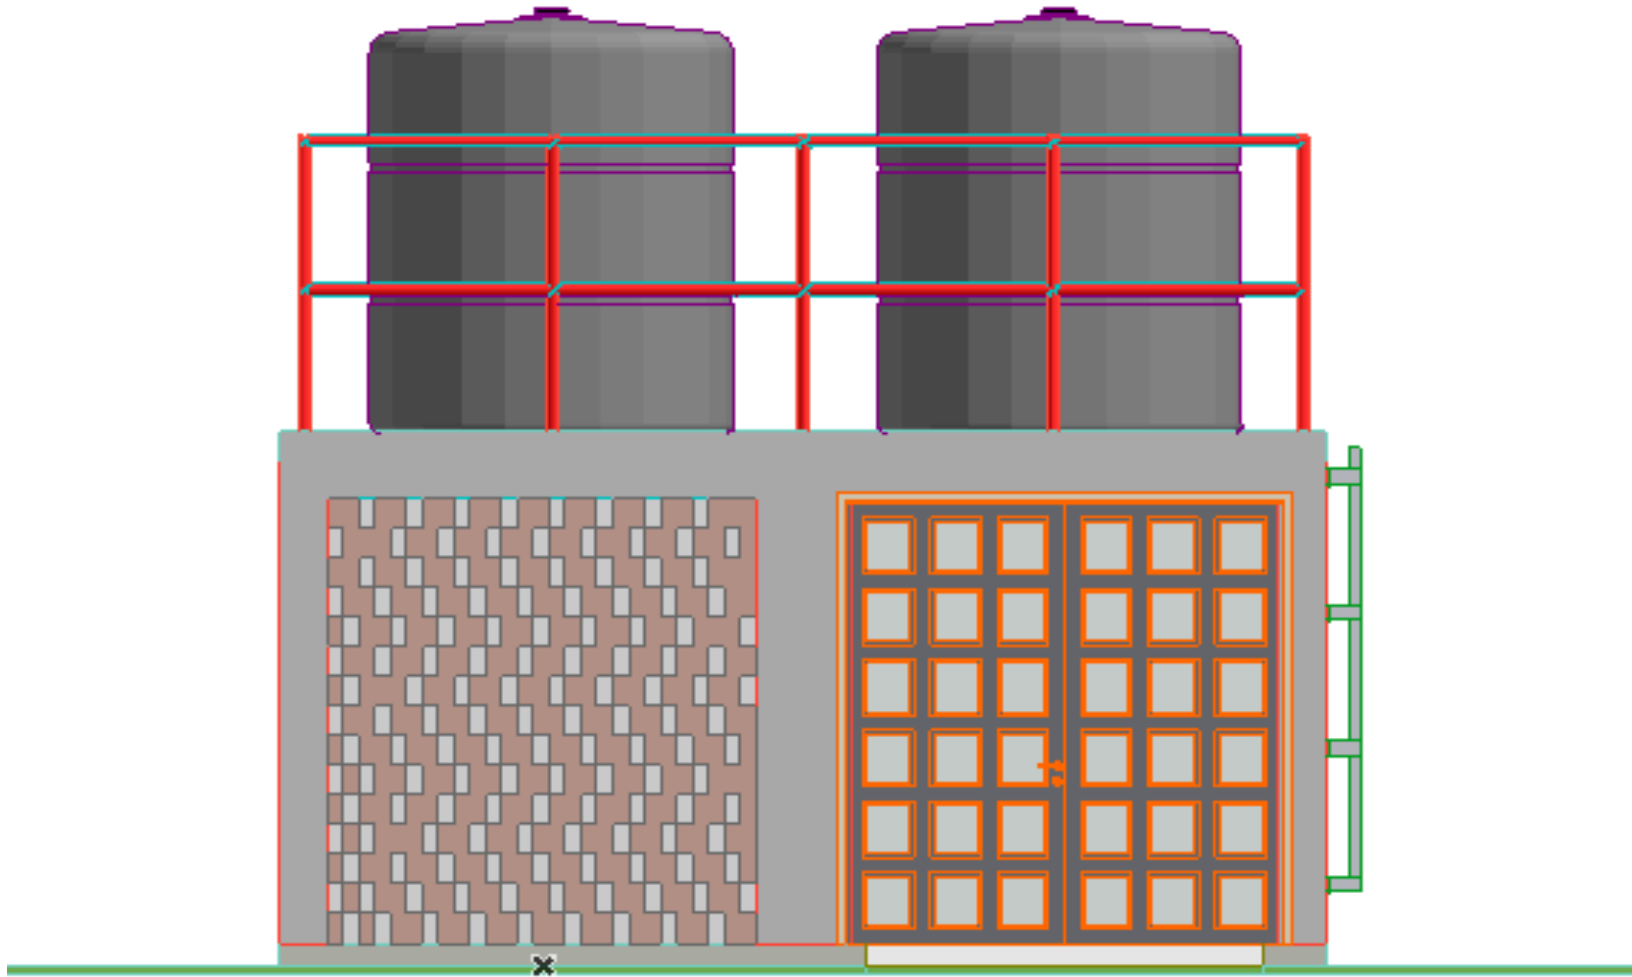

WATER TOWER IN DORMITORY

